


820 Latching Relay

Installation Instructions

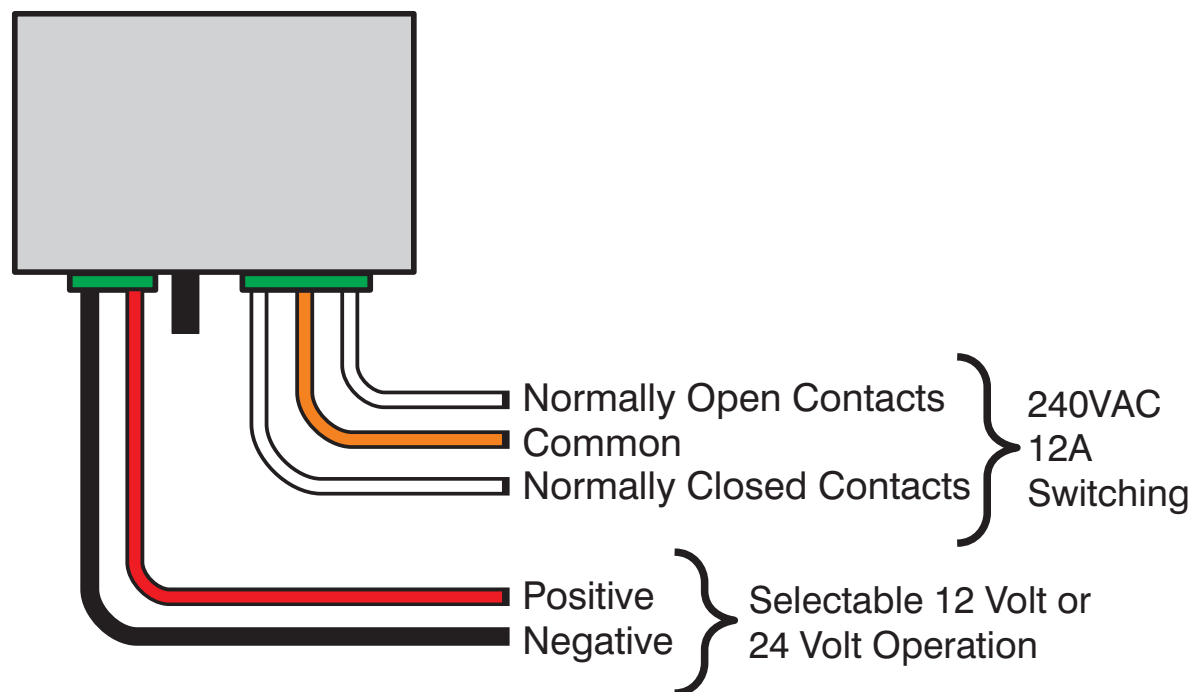

A momentary positive pulse supplied to the trigger input will change the state of the relay contacts. The relay contacts will remain in that state until triggered again.

It uses no current in its rest state (either ON or OFF) and uses a short pulse of current during switching only.

The device triggering voltage can be selected from 12 volts or 24 volts by means of a link.